



**Diversified
Components, Inc.**

The 2018 UL 48 Full
Requires LED Sign
Installations and
Instructions Utilize
Insulating Pass-Thru's!

Quik-Connects™ Insulating Pass-Thru System

Meet the New 2018 UL 48 Full
and Sign Code Requirements
when Installing LED Signs

Install in the sign
while in your
UL Sign Shop!
Save installation
time and money
in the field!



Made in
the U.S.A.

UL 879 Listed
and in the
UL iQ for Sign
Components
(SAM Manual)



E485 158
Sign Accessory






*Diversified
Components, Inc.*

The 2018 UL 48 Full
Requires LED Sign
Installations and
Instructions Utilize
Insulating Pass-Thru's!

The Quik-Connects™ Insulating Pass-Thru System

UL 879 Listed
and in the
UL IQ for Sign
Components
(SAM Manual)
UL
E485158
Sign Accessory

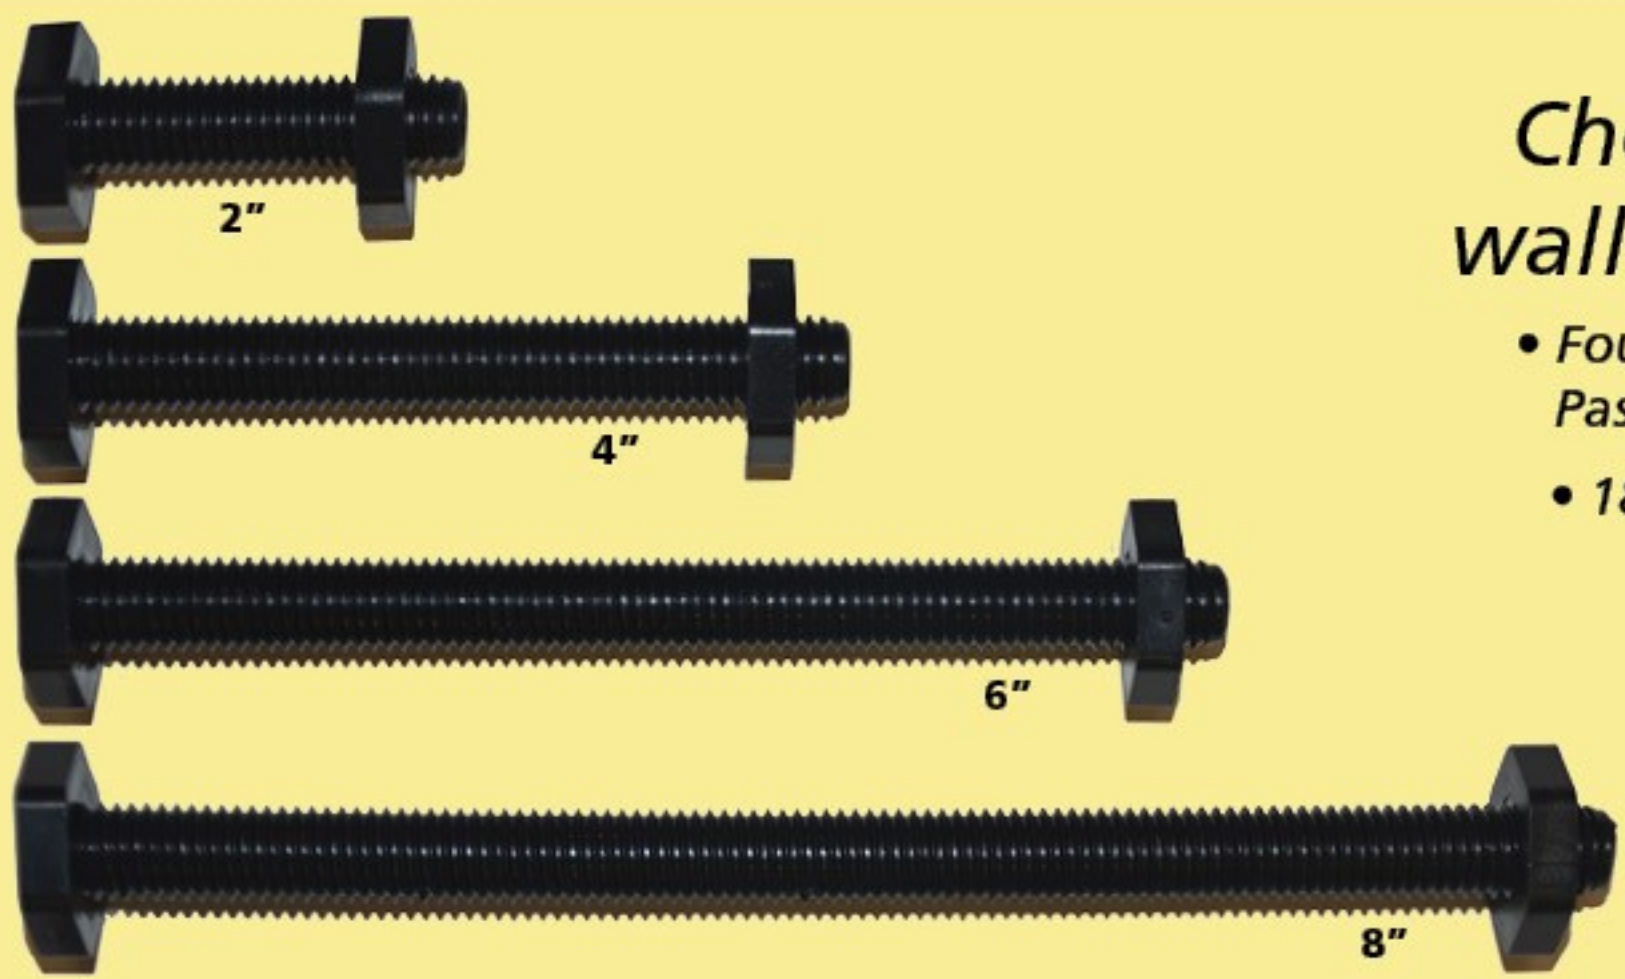

*Choose your
wall thickness*

- *Four standard rigid Pass-Thru options.**
- *18" & 24" flexible Pass-Thru's also available!*

* - Also rated for use with GTO wire!



Female



Male

Choose a locknut



*Add Flexible
Quik-Connect™ (NMG)*



1, 2 and Twist = Done!™

Meet the New 2018 UL 48 Full Requirements when Installing LED Signs!

The Quik-Connects™ System saves you installation time and money!

Don't forget our Sign Dimmers for LED, Neon, Fluorescent & HID applications!



PS-LED series



NE-5P



NE-10



NE-15



200 Rome Court, Fort Collins, CO 80524

Phone: (970) 484-9025

Fax: (970) 493-4125

Email: Info@LEDSignComponents.com

Web: www.LEDSignComponents.com




Represented by:



The 2018 UL 48 Full and Sign Code Articles 300.4(A-D) and 600.33 require LED Sign Installations utilize insulating pass-thru's with LED sign wiring. This includes the wiring from the sign, through the wall, and to the Class 2 Power Supply on its secondary output.

How to use Diversified Components' Quik-Connects™ System

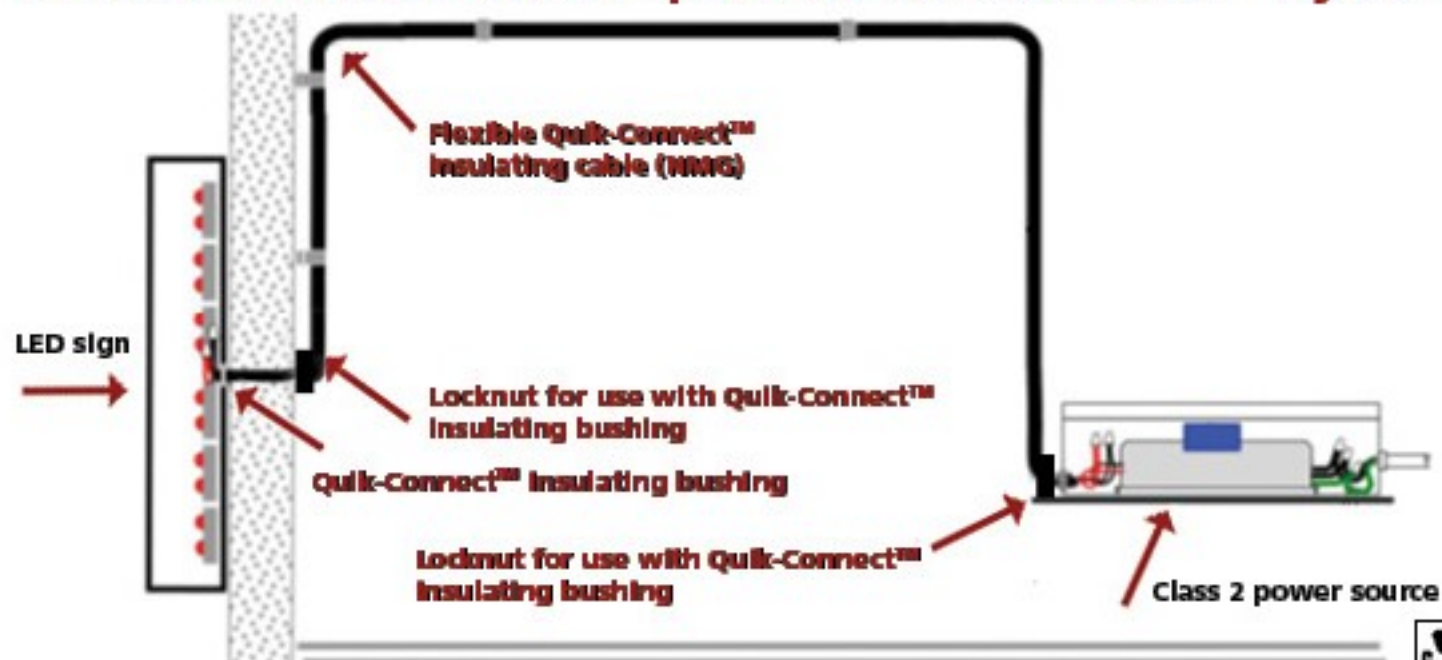

Typical installation



Component items must be Listed by a Nationally Recognized Testing Laboratory (NRTL) such as UL or ETL.